


BUREAU ENGINEER *gll* DRAFTSMAN, REB DATE 6-6-84 SCALE 1"=0'-6"

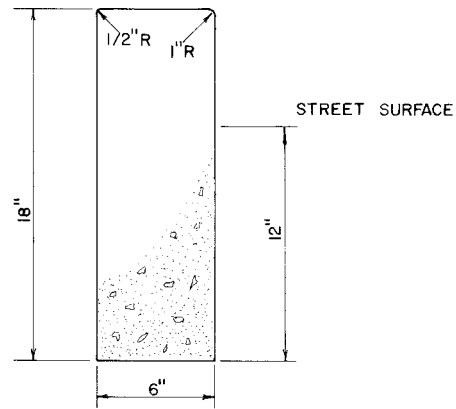

NOTES:

- 1. EXP JOINTS SHALL BE LOCATED AT ENDS OF RADIUS.
- 2. EXP JOINTS SHALL BE INSTALLED AT 40 ft., MAX.
- 3. EXP JOINTS SHALL BE LOCATED A MIN. OF 5 ft. FROM INLET STRUCTURE.
- 4. PRE-CUT EXP JOINT MATERIAL SHALL BE USED IN ALL EXP JOINTS.

CONCRETE TO BE CLASS 'A'

REVISIONS			
NO.	DATE	BY	REMARKS
1	5-30-85	L.R.H.	REMOVED DIV. OF PUBLIC WORKS (T.BLK.)
2	7-23-87	D.H.G.	ADD: CLASS 'A'
3	3-10-88	D.H.G.	REMOVED DEPARTMENT (T.BLK.)

CITY OF MEMPHIS
DIVISION OF ENGINEERING

DESIGN STANDARD
FOR
6"x18" VERTICAL CURB

Martin L. Jacobs 6/6/04
CITY ENGINEER DATE